


FROM POWER SOURCE 120V & 240V



1. ENSURE THE SYSTEM IS GROUNDED
2. MAT HAS NO POLARITY
3. WIRE FROM THERMOSTAT TO JUNCTION BOX SHOULD BE SIZED ACCORDING TO LOCAL ELECTRICAL CODE REQUIREMENTS.

ELECTRICAL ROUGH-IN

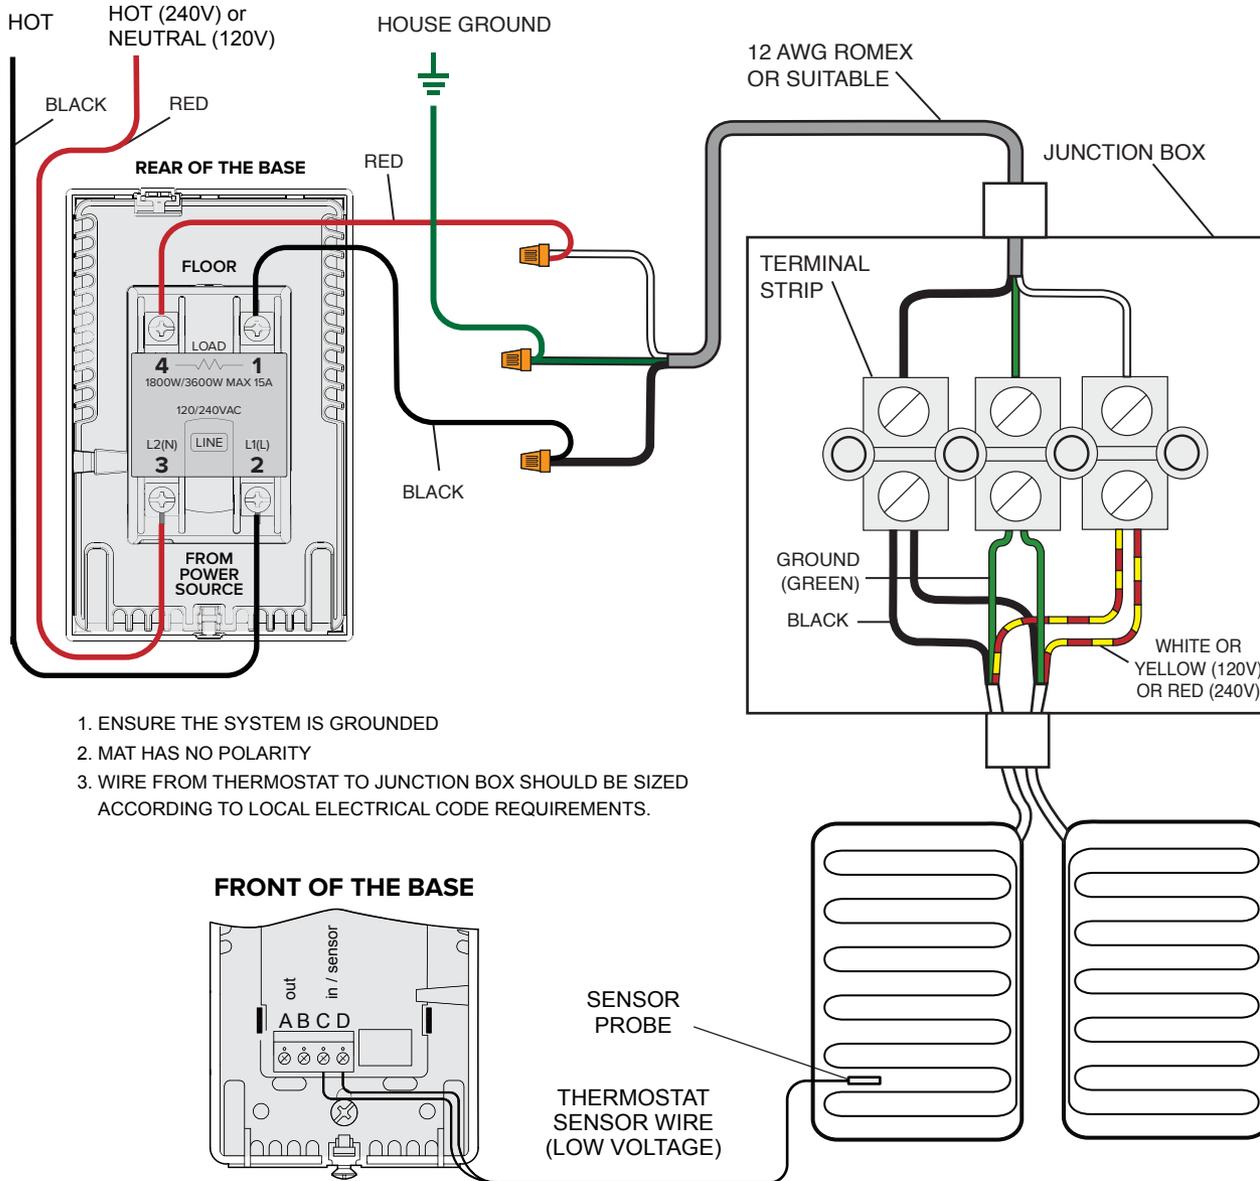