



WARMLY YOURS
MAKING COMFORT EASY

2 Corporate Drive
Long Grove, IL 60047
Ph. (800) 875-5285 Fax (800) 408-1100
Web. www.WarmlyYours.com

Dear Customer,

Thank you for purchasing your radiant heating control from WarmlyYours. WarmlyYours is dedicated to making comfort easy and we continually strive to provide our customers with the best controls in the industry.

WarmlyYours sells this product under part number SCV-120. The control's manufacturer identifies this same part with the model number of LCD-7A in all the documentation provided with the control.

If you have any technical questions related to this control or the installation of any of our radiant heating systems, please call our 24/7 installation team at (800) 875-5285 or visit our website at www.WarmlyYours.com.


WarmlyYours
Technical Team



Model LCD[®]-7A Snow Switch[®]

Part Number 21035

Installation Manual

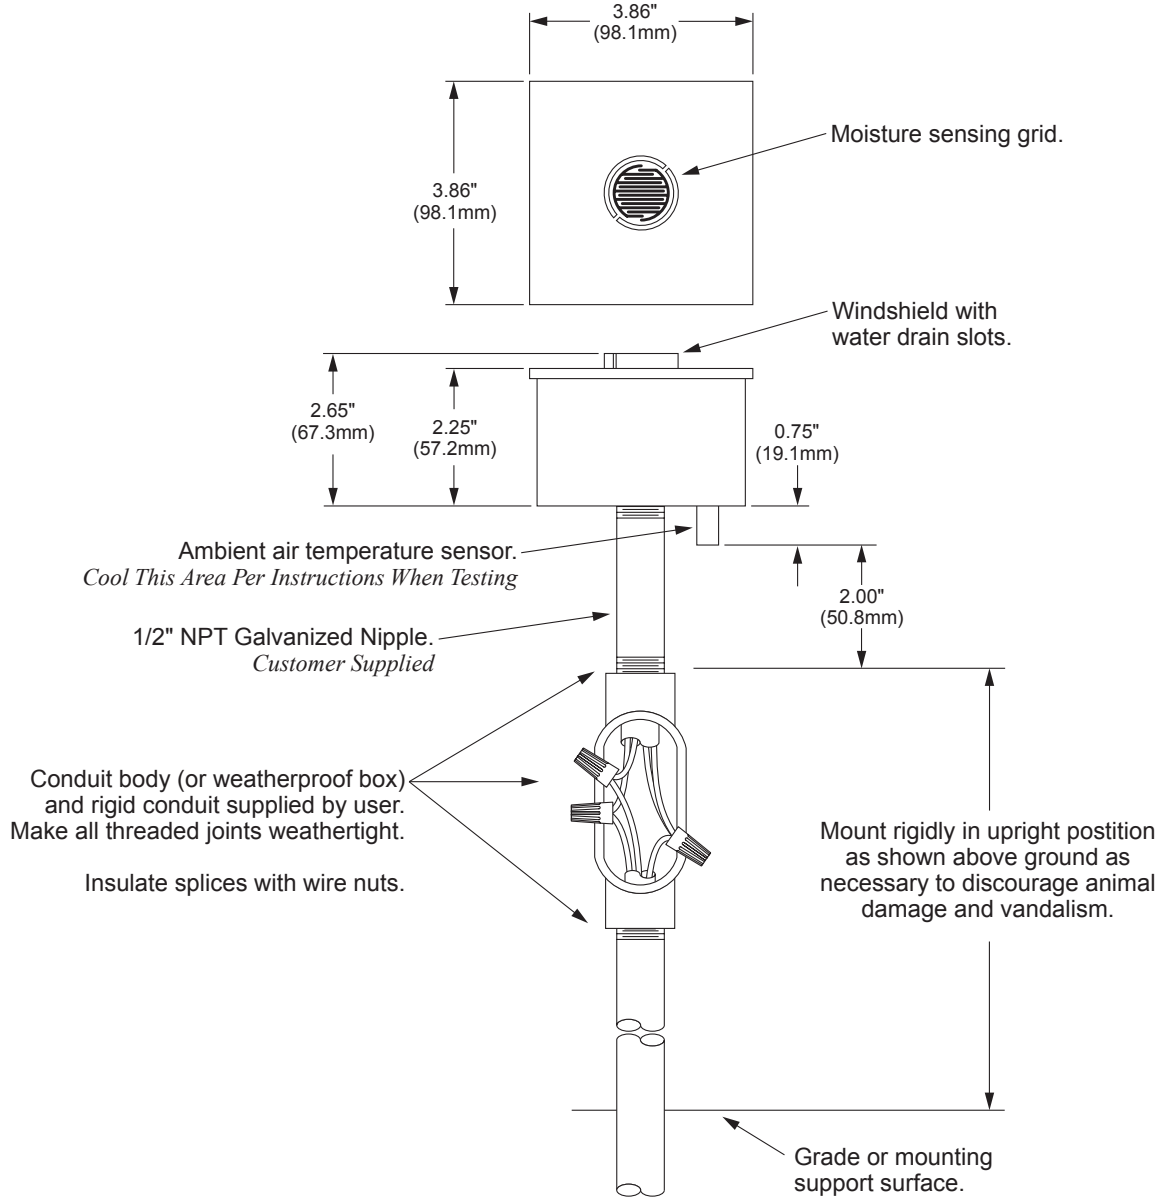

Installation

Mount sensor securely in upright position in clear (open) area typical of area to be melted, either above roof line or removed from building as to not be protected from the falling snow.


AVOID overhead trees, shrubs, wires, eaves, etc., and following or blowing debris.

AVOID vehicle and foot traffic. Do not create a safety hazard.

AVOID exposure to artificial heat sources and excessive shock and vibration.

Install per all applicable electrical and building codes and regulations.

INSTALL IN ACCORDANCE WITH THE REQUIREMENTS OF ALL APPLICABLE ELECTRICAL AND BUILDING CODES AND REGULATIONS. ENSURE THAT ALL CONDUIT/CABLE TERMINATIONS ARE WATERTIGHT.

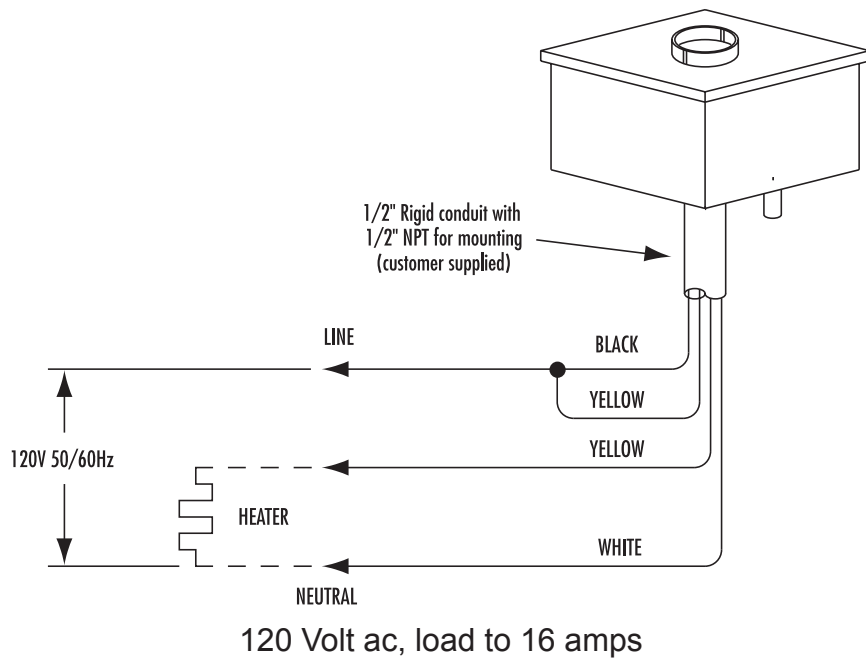

Post-installation Snow Switch® test

Most problems result from installation errors. Before testing, verify that unit is properly installed.

1. Connect power to snow melting system. Wait fifteen seconds, system should not actuate.
2. Using ice water or other cooling agent and cool ambient air temperature sensor below 38°F(3.3°C), system should not actuate. Apply moisture to moisture sensing grid, system should actuate in less than 15 seconds.
3. Dry moisture sensing grid. Disconnect power to snow melting system. Wait one minute, then reconnect power. If system actuates ensure sensing grid is dry and ambient air temperature is above 38°F(3.3°C), then repeat this step.

Operating temperature

| | |
|-----------------|----------------------|
| Range (Min/Max) | -40/140°F (-40/60°C) |
| Setting | 38°F (3.3°C) |
| Tolerance (+/-) | 1.5°F (-17°C) |

Lockout temperature

| | |
|-----------------|---|
| Setting | — |
| Tolerance (+/-) | — |

Hold-On Timer

| | |
|-----------------|-------|
| Nominal timer | 3 Hr. |
| Tolerance (+/-) | 1% |

Output Relay

| | |
|------------------------------------|-----------|
| Rated Voltage (volts a-c 50/60 Hz) | 120 Volts |
| Maximum Load | 16 Amps |

Supply

| | |
|------------------------------------|-----------|
| Rated Voltage (volts a-c 50/60 Hz) | 120 Volts |
| Tolerance (+/-) | 10% |
| Nominal Power | 0.6 Watts |

Questions and Comments

For technical help, questions or comments concerning this product or any of Environmental Technology, Inc. products contact Customer Service between 8:00 a.m. and 5:00 p.m. EST.

Voice: (800)234-4239 in the USA and Canada or (574)233-1202 everywhere
 Fax: (888)234-4238 in the USA and Canada or (574)233-2152 everywhere
 Email: helpdesk@networketi.com
 Web: <http://www.networketi.com>

DISCLAIMER

Environmental Technology, Inc. makes no representations or warranties, either expressed or implied, with respect to the contents of this publication or the products that it describes, **and specifically disclaims any implied warranties of merchantability or fitness for any particular purpose.** Environmental Technology, Inc. reserves the right to revise this publication and to make changes and improvements to the products described in this publication without the obligation of Environmental Technology, Inc. to notify any person or organization of such revisions, changes or improvements.



Environmental Technology, Inc.

1850 N Sheridan Street, South Bend, Indiana 46628

The ETI logo, Snow Switch, LCD and We Manage Heat are registered trademarks of Environmental Technology, Inc.
 © 2008 Environmental Technology, Inc. All rights reserved.

PN21036 rev A 05/08